


J:\Indl_Service\Project Files\Greenwich_High_School\GIS\Projects\Exceedances_of_Screening_Criteria_For_Sediment_03_02_12.mxd

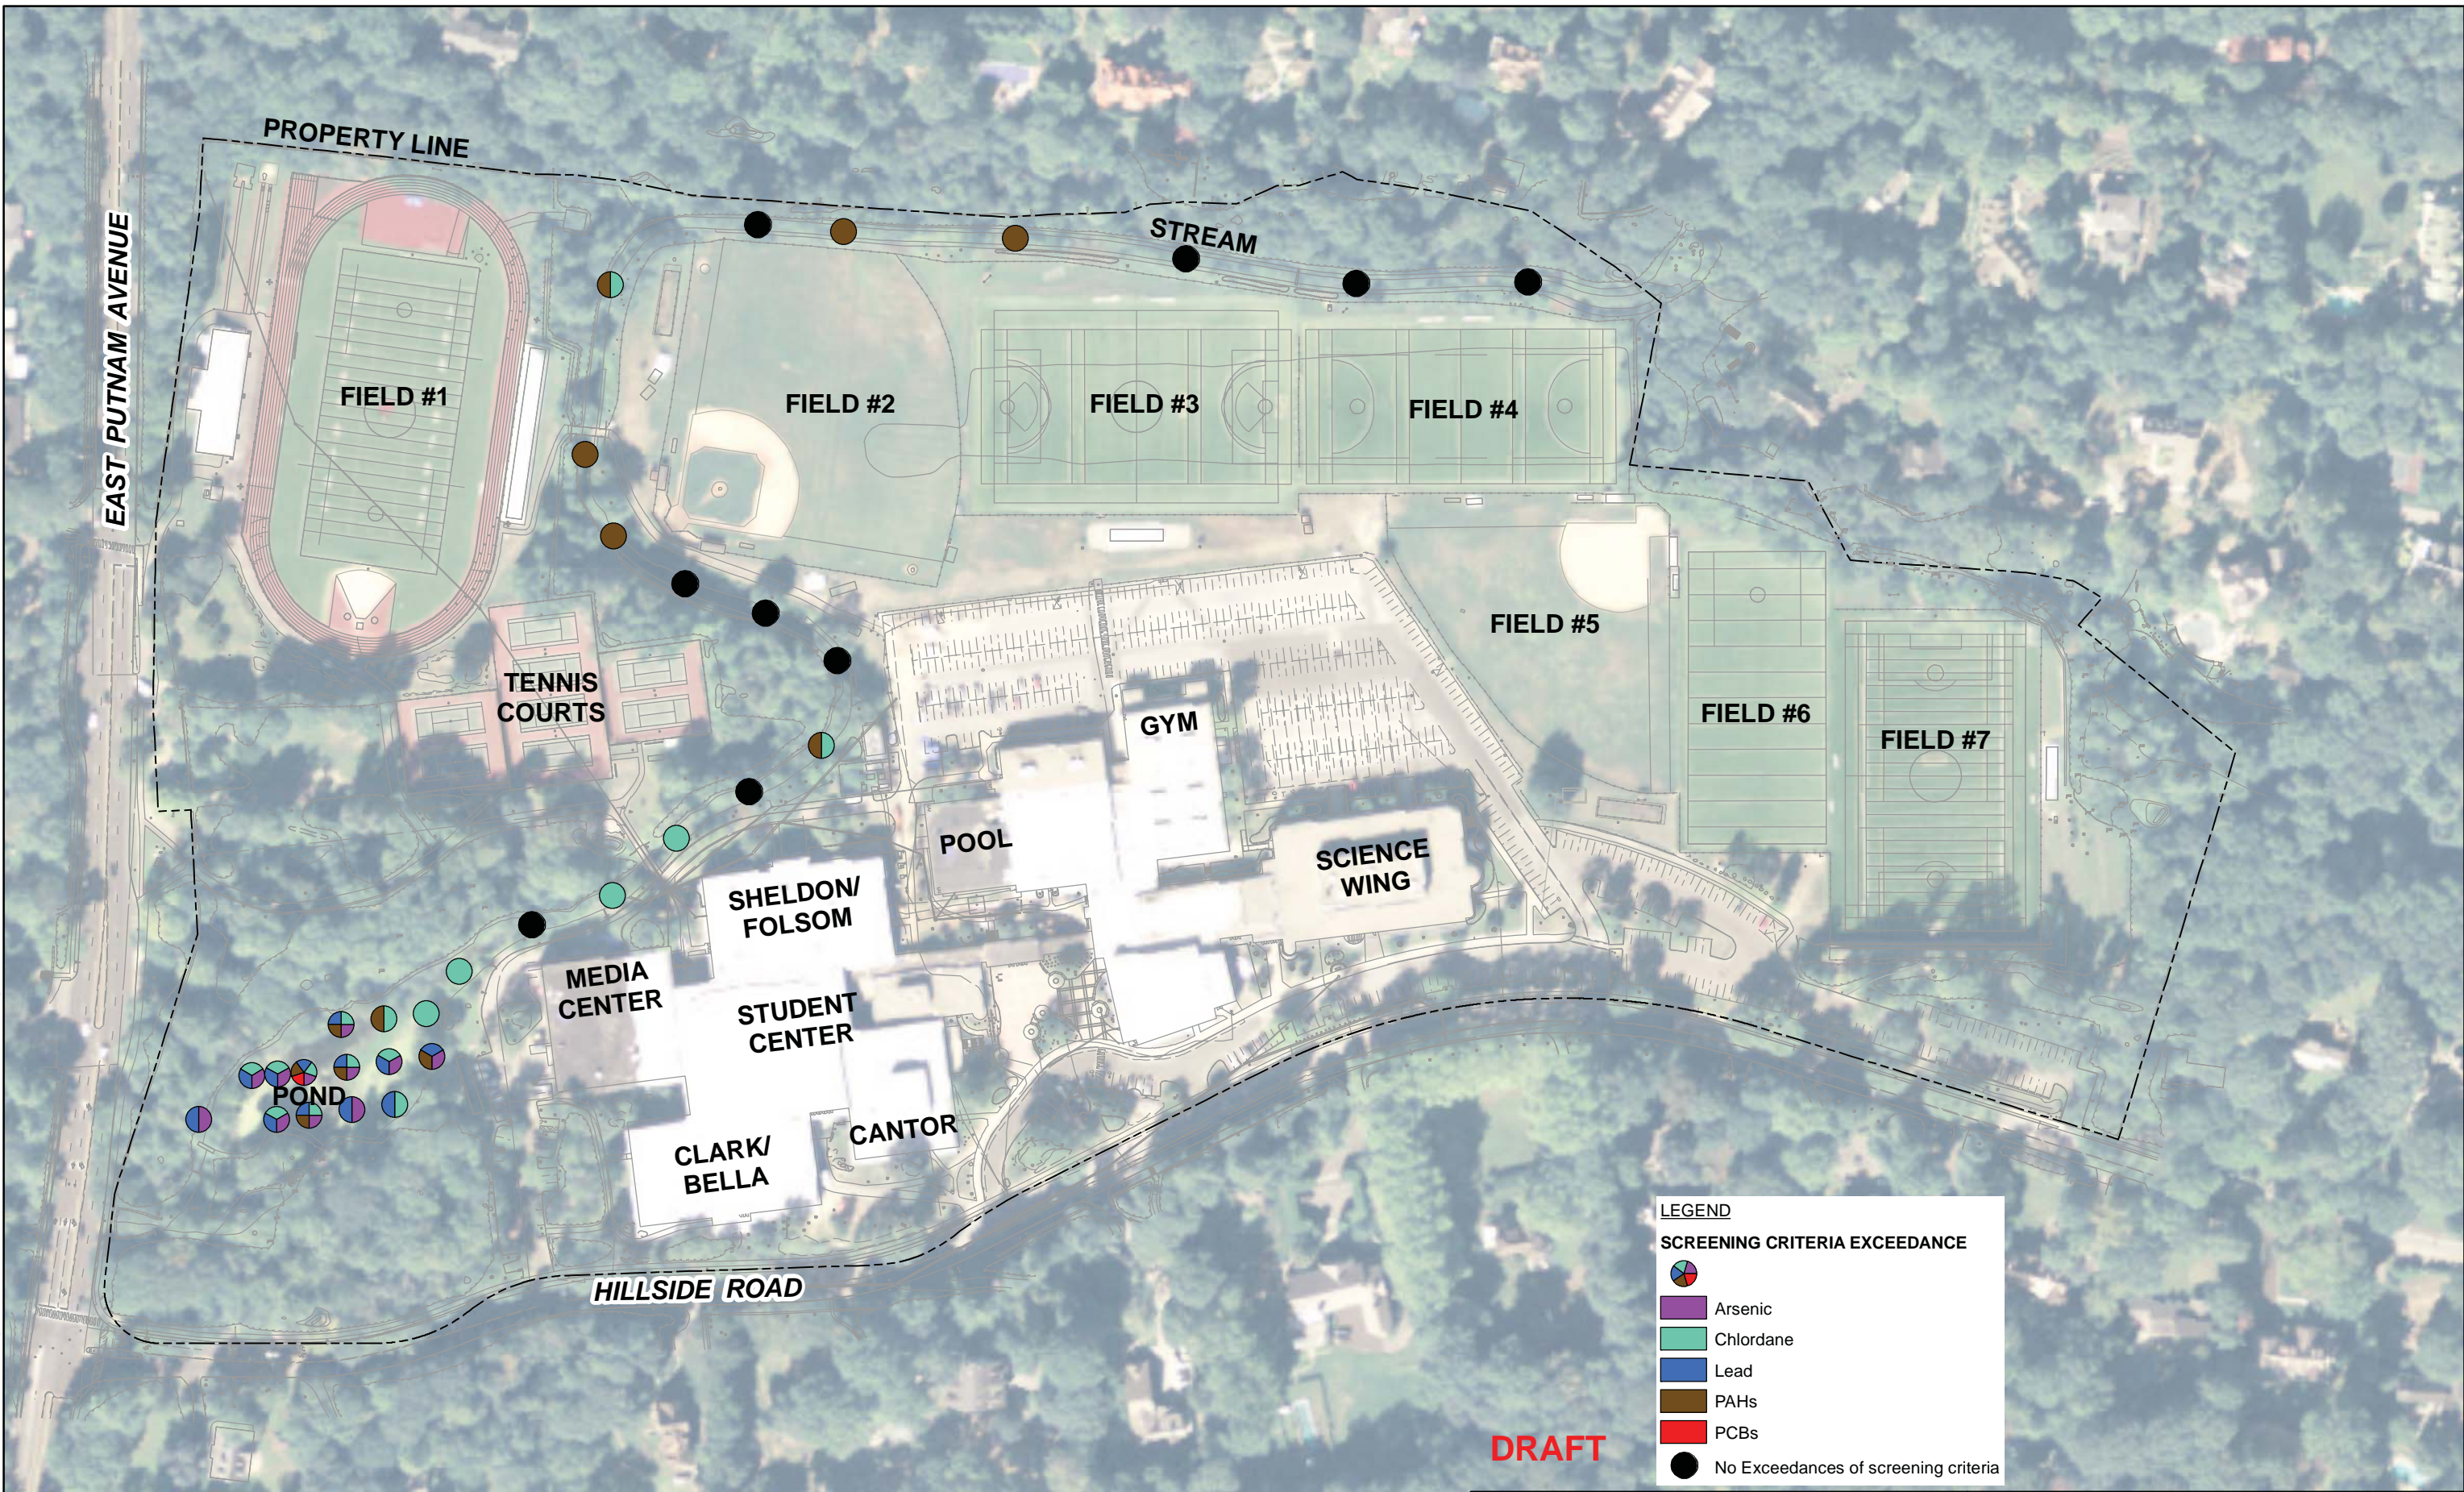


LEGEND

SCREENING CRITERIA EXCEEDANCE

- Arsenic
- Chlordane
- Lead
- PAHs
- PCBs
- No Exceedances of screening criteria



SOURCE:
2010 AERIAL ORTHOPHOTO FROM STATE OF CONNECTICUT
DEPARTMENT OF ENERGY & ENVIRONMENTAL PROTECTION.



GREENWICH HIGH SCHOOL 10 HILLSIDE ROAD GREENWICH, CT 60225155.0500			EXCEEDANCES OF SCREENING CRITERIA FOR SEDIMENT	
DATE: 03/02/12	DRWN: J.E.B.			FIGURE